

REACTIVE POWER CONTROL FOR WIND UNIT IN COLLABORATION WITH GRID AND DIESEL POWER PLANT

¹Asia Rafiq, ²Tahir Izhar, ³Asim Naveed, ⁴Muhammad Munwar Iqbal

¹Electrical Engineering Department, University of Engineering & Technology, Lahore, Pakistan.

²Computer Science & Engineering Department, University of Engineering & Technology Lahore, Narowal Campus, Pakistan.

^{3,4}Department of Computer Science, University of Engineering & Technology, Taxila, Pakistan

aasia03@gmail.com, tizhar@gmail.com, asimnaveed@uet.edu.pk, munwariq@gmail.com

ABSTRACT- Energy is being the life line for the economy of any country so to stabilize the economy the rapidly growing demand of energy, especially power generation must be fulfilled. The conventional power generation cannot fulfill this power generation demand so for this purpose self-sustaining generation sources are used. The wind farm unit is the most common and reliable green source of power generation but due to different load types at consumer such as linear and nonlinear load and at the same time wind distributed generation unit integration with the other distribution unit in conventional power grid faces power quality problems. To improve the power quality of the power system the concept of micro grid is utilized. In Micro Grid different Distribution Generating units DGs are interconnected in the system and micro grid switches in its switching modes as per system requirements. During switching mode of operation from Grid-connected mode to Island mode power quality issues arise such as voltage variations or flickers. In this paper concept of Micro grid is applied with wind farm unit as renewable energy resource and industrial load is fed. The test model is simulated in MATLAB/SIMULINK. FACTS device D-STATCOM is used to overcome the power quality issues and two reactive power controls schemes are simulated and their results are compared with micro grid switching modes.

Keywords: Wind Farm DFIG, Microgrid, PQ, FACTS, D-STATCOM.

I. INTRODUCTION

The renewable energy resources such as wind turbine, fuel cells and micro hydro turbines are implemented for sustainable and green energy production. As these sources are not capable to feed the total load of country so these sources are connected with the other conventional distribution generating units in power grid system. Usually these distribution generators are located closed to the load centers and during their synchronization with the conventional power grid system many power quality problems arise [1]. To run together these multiple generating sources without any major modification the micro grid concept is implemented for precise control of distribution and generation. In micro grid implementation different power generating unit with their associated load are connected as a single entity. Although micro grid concept facilitate with more precise and reliable control over generating units and load management but it may not resolve all the power quality problems. In fact in case of renewable resource the micro grid may cause more severe power quality problems while switching from its one mode of operation to other mode of operation which results in major power quality and system reliability. As the output of renewable resources is directly dependent on the input parameters such as wind speed in case of wind farm unit, so the power quality or system reliability needs more attention because these input parameters may vary and result in poor power quality. Due to installation of these DG units in power system the reliability and quality of power system is always susceptible. Micro grid must perform its operations efficiently and it must be capable to drive the utility load in both of operating modes i.e. Island mode and Grid-Connected mode. As the inductive load caused lagging power factor and at the transition from Grid-connect mode the micro grid may not be able to provide the power to the load due to severe dip in voltage level. Similarly in case of non-linear inductive load harmonics are produced in the power system which decreases the efficiency and life of load utilities. So to have high power quality DGs unit must fulfill the load requirements. But DG

units have their own limitation and DG units cannot provide or involve in voltage regulations therefore a precise and reliable source is required to overcome these power quality problems. To maintain the constant voltage at the output terminals in medium and high voltage applications tap changer transformers are used. Capacitor banks are also utilized at the load end for purpose of voltage regulation. Similarly, synchronous machine can provide voltage regulations by controlling power factor through their field current. The tap changer transformers and synchronous machines provide slow response so to get fast response the Flexible AC Transmissions FACTS devices are the best choices. These FACTS devices are based on semiconductor power electronics circuits [2]. Different FACTS devices are used to improve the power quality of the system depending on the system requirements such as DVR, D-STATCOM and SVC [3]. These devices provide voltage or power compensation in series or parallel mode depending on their connection installation in the existing power system.

In this paper the idea of micro grid is implemented with wind farm unit as renewable resource to drive the real-time industrial load. As during transition of micro grid from grid connected mode to island mode the load is fed only by the wind farm and during this transition a severe voltage sag is observed at the load terminal which is not sufficient to drive this critical load. Similarly the most of industrial load is of inductive nature that causes degrading of power quality by introducing lagging power factor. For the purpose of safe island transition and fulfill load requirement D-STATCOM is implemented in the system with two different reactive power control techniques and their results are compared in **MATLAB/SIMULINK simulation.**

The rest of the paper is sectionalized as; Section-II Presents a Renewable Resource used in Micro Grid; Section-III expresses power quality problems and solutions; Section-IV presents Test system Section-V discusses analysis & results and in Section-VI this paper is concluded.

II. MICRO GRID

Micro grid is a single entity that is composed of dependable sources of power generation, distribution network of medium or low voltage and utility load with precise control of load management [4]. Micro grid is implemented in compact area with distribution generation such as micro turbine, fuel cells or wind turbine with their related devices such as condensers, batteries and utility loads. The micro grid facilitates power system with more precise load management and reliability of power supply. The precise voltage and power control improved system efficiency by minimizing transmission losses and fast response. In order to enhance power supplied-costumer interaction micro grid comes with feature of smart metering.

A. Operating Mode of Micro Grid

a. Grid Inter Connected Mode

The standard operating mode of micro grid is Grid Inter-Connected mode in which power is shared with utility grid system and micro grid.

b. Island Mode

As the power system protection isolate the faulty system from the healthy system so in case of any disturbance or fault near the utility grid bus or in utility grid, the micro grid is isolated from the utility grid and it goes into its Island mode. In island mode the local load is drive by the distributed generation units.

B. Types of Micro Grid

a. Micro Grid with Tri-generation

Tri generation phenomenon is also defined as CCHP in which hydrocarbons are burnt to generate electricity. The tri-generation is very efficient eco-friendly energy system

b. Multi Megawatt Micro Grid

In Multi megawatt micro grid the DG units with large power capacity are connected due to which conventional power inverter sources become impractical for switch. Usually internal combustion engine with synchronous generators are used in these micro grids

c. Industrial Micro grid

These micro grids fulfill high power requirements for commercial purpose. These micro grids provide onsite power generation which can feed the local industrial loads with maximum efficiency. Industrial micro grids are usually owned by the private companies for their local productions and implement smart load management as per their business requirements.

C. Characteristics of Micro-Grid

As micro grid is comprised of different generation sources and local utility loads with required compensation devices or equipment so switching of micro grid from one mode to other mode keeping in view the power quality of system [6]. For the purpose the micro grid control schemes to be flexible and self-guided the following two characteristics must be considered **i.e. peer to peer, plug and play.**

a. Peer-to-Peer

The peer-to-peer feature of micro grid ensures that the micro grid must be operational in case of any fault in any one of the generation source. The peer-to-peer characteristic enhances the power system reliability.

b. Plug and Play

The micro grid is connected with different power sources and these power sources can be connected or dis-connected as requirement of load. By utilizing the plug and play feature of micro grid these source can be control with complete ease.

D. Renewable Energy Resources

To fulfill rapidly growing energy needs of world it is necessary to mix up the conventional power sources with the renewable energy resources. Pakistan has great potential for these self-sustaining and green sources of energy especially for wind energy and solar energy. Many projects of wind power and solar energy are being installed in Pakistan and few of these projects have been commissioned and providing electricity in national grid. Although these energy resources are cheap and efficient but need real attention to maintain the high power quality of existing power system. The different types of wind farm units are available but in this work DFIG is used.

E. DFIG Wind Farm

The induction machines in which both of windings i.e. stator winding and rotor windings are being fed with AC current are known as Doubly Fed Induction Generators. In DFIG [5] [6] the output torque is produced by magnetic field of stator wind which has been results by interaction of rotor magnetic field. A discrete amount of power is available at wind turbine output as it is directly dependent on the input wind speed.

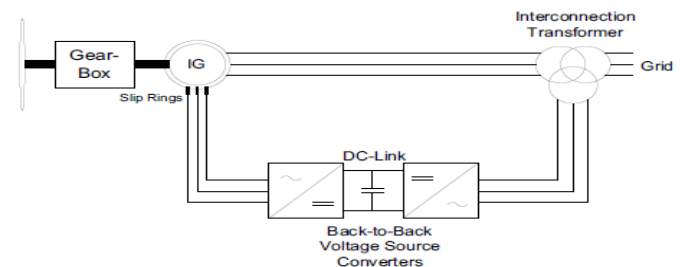


Figure 1: DFIG wind farm connection.

On basis of operational speed function the wind farm units are classified as relatively fixed speed and variable speed machines. The figure-1 illustrate the simple model of DGIG in which a DC Capacitor link is working as a buffer between generator and grid side, stator windings are connected with utility grid through setup transformer.

III. WIND FARM AND POWER QUALITY IN MICRO-GRID

Although Micro grid concept is one of the most emerging technology due to its diversified characteristics but in case of wind farm the power quality becomes a severe problem. The conventional power DG units can maintain desired voltage level at output terminal to run the local load but in case of Island mode or failure of convention power DG the renewable DG unit must be capable to drive the local load. Although for low penetration of wind farm high power quality can be observed but for high penetration of wind energy the balance of power network may be disturbed due to variation in wind speed or abrupt changes in system configuration. The balance of power is very important for reliable supply and smooth running of power system due to

unbalance of power system the frequency of the system varies which ultimately result in total system collapse. At the same time the voltage stability is very important to keep power system synchronism in alive stage at time of micro grid switching from one mode to other mode or in case of sudden changes in load conditions. Similarly the short circuit fault near the main grid bus bar or at transmission lines may cause a sag in system voltage which results in voltage drop beyond the safe limit and power system may leads to total system blackout. Therefore to improve the power quality it is essential to have a voltage supporting system to maintain or stabilize the voltage level at desired value in case of utility grid disconnection in island mode of micro grid when the utility load is fed by the wind farm unit.

IEC Standards [7] address the power quality problems during operation of micro grid.

The wind farm unit efficiency is directly related to following distinct features;

- 1- The useful life period of utility or power equipment is mainly depend on the voltage stability and at the same time voltage variations may result erroneous tripping of power source which leads unnecessary interruption in power supply.
- 2- Due to unnecessary tripping of DG units the power System reliability is always on risk.
- 3- Sudden variations or switching from one mode to other mode in micro grid produce harmonics in power supply due to which consumer at load end faces poor power quality..

A. Reactive power control techniques

In AC circuits the part of apparent power which is temporarily stored in capacitive or inductive element during the first quarter of AC input cycle is a Reactive power. It is actually an oscillatory power that stored in first half quarter and fed back in system in the following next half quarter. The reactive power has the direct impact on the power quality of power system as the system voltage level is dependent on reactive load so the voltage can be limit to desired level by controlling the flow reactive power. For the compensation of reactive power VAR controller connected in Series/Parallel configuration or power electronics based FACTs devices are used.

a. Shunt Configuration

Figure-2 presents the simple AC power system with legging power factor which is depicted in its phasor diagram. V_2 is the load voltage and it is clear that load current I_p is legging this reference load voltage by certain angle ϕ . This is uncompensated power system and additional reactive power has to be generated due to which voltage stability is affected.

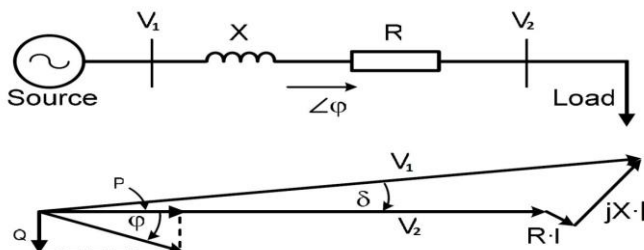


Figure 2: Power System without Compensation.

The more current is drawn from the circuit which causes more power losses.

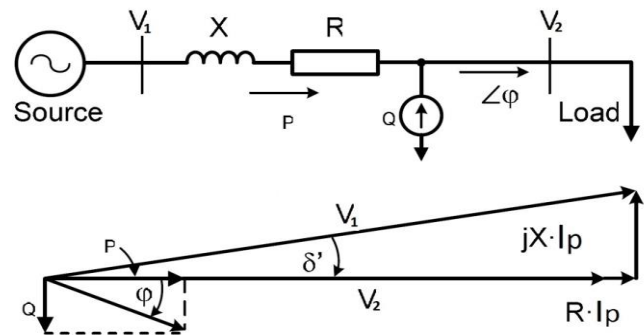


Figure 3: Shunt Compensation for power system.

To minimize these additional power losses a compensation system is required figure-3 presents the parallel configuration for shunt compensation.

b. Series Connection

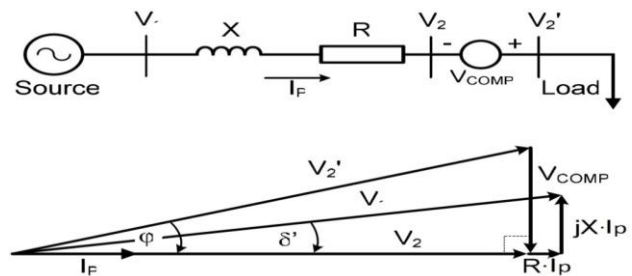


Figure 4: Series Compensation for power system.

In series configuration capacitor banks are installed in series of the power system due to which the equivalent reactance of the system is reduced and voltage is injected in the system as shown is figure-4

B. FACTS Devices

The DFIG initially draw reactive power from the system and the grid system or other DG units are not equipped to perform voltage regulation. To overcome this power quality problem an external voltage supporting system is installed that is known as Flexible AC Transmission Systems. These devices are simple reactive power controllers which control the reactive power flow. Depending on their operations different FACTS are used i.e. UPFC, SVC,D-STATCOM, and DVR [8].

a. Distribution Static Compensator

D-STATCOM is installed in parallel configuration as shown is figure-5. The D-STATCOM is power factor compensation device which stabilized the system voltage

industrial load is run at 400 Volts so a distribution step down transformer 11/40 KV is simulated.

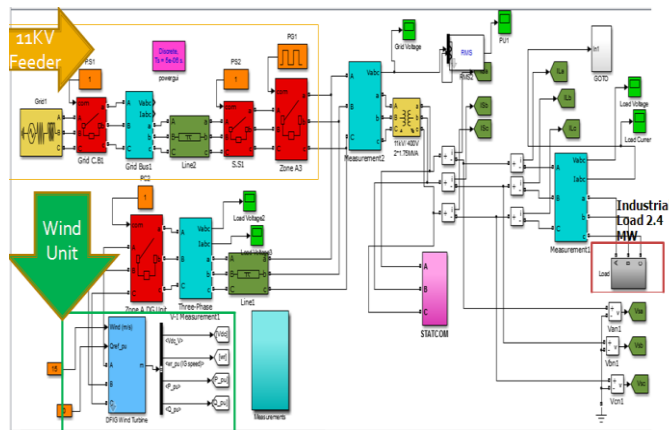


Figure 8: MV Network model based on Matlab/Simulink.

As to observe the micro grid mode of operation the static switches are used as circuit breakers which work to control the operation of micro grid and also isolate the faulty section in case of a fault. To have a renewable energy resource in micro grid a DFIG wind farm unit with capacity of 1.8 MVA is simulated as shown in figure-8

B. MODEL OF RENEWABLE DFIG

The renewable wind farm unit based on DFIG is implemented using MATLAB/SIMULINK as presented in figure-9. As the AC current is fed through both stator and rotor windings therefore two converters are simulated. A PWM based inverter composed of IGBTs is simulated. The DFIG wind farm has power rating of 1.8 MVA and its stator winding is connected to the grid bus through setup transformer and provides required power to load.

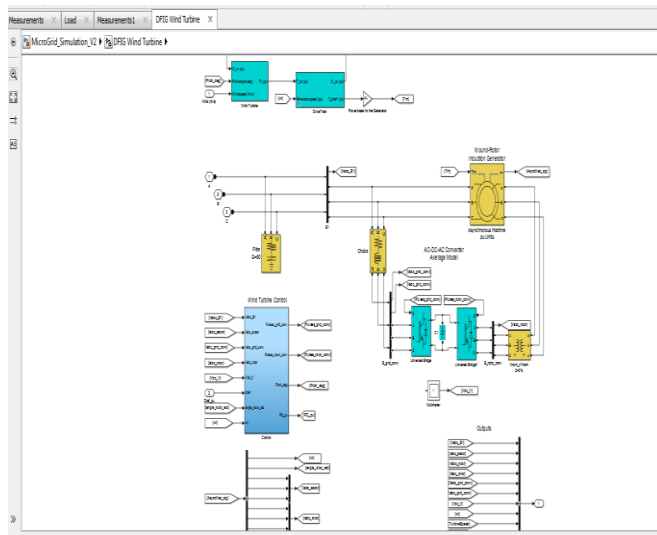


Figure 9: Matlab /Simulink Model for DFIG.

C. MODEL OF D-STATCOM

D-STATCOM is simulated to support the system voltage by providing reactive power compensation as shown in figure-10.

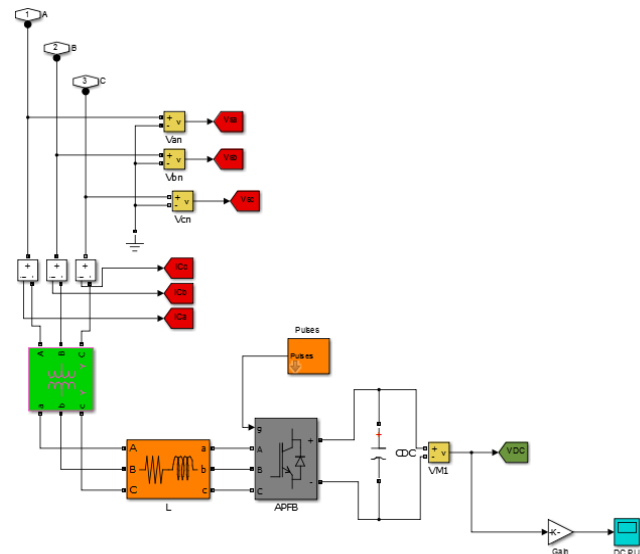


Figure 10: D-STATCOM Model.

The two controlling techniques based on Park's transformation and generalized control algorithm is implied in MATLAB/SIMULINK. The performance of these two control algorithm is analyzed to eliminate the harmonic distortion in the system due to switching and non-linear behavior of the load.

V. ANALYSIS AND RESULTS

In this section the result for the two control schemes are discussed and voltage stability of the system is analyzed.

a. Simulation Results with D-STATCOM

Figure-11 depicts the transitive voltage sag during the time of switching of micro grid such voltage sag is not acceptable for smooth running of power system.

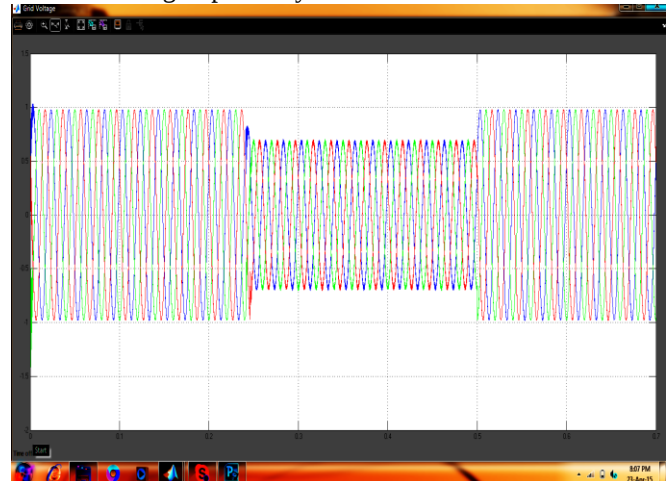


Figure 11: Voltage sag during Micro grid Operation.

At the same time reactive and active powers are analyzed as figure-12 illustrates. It is clear that the reactive power is drawn from the system at the time switching from Island mode to grid-connected mode.

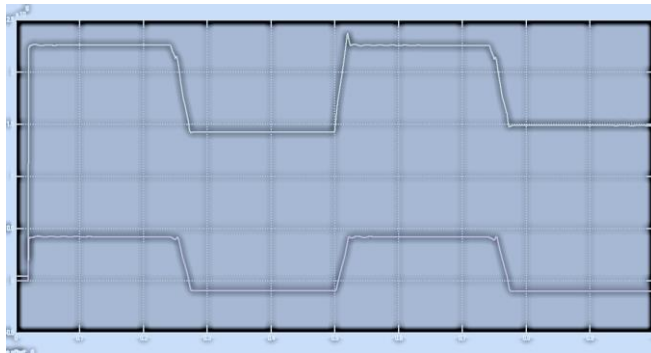


Figure 12: Reactive power drawn from grid during Microgrid Mode Switching without DSTATCOM.

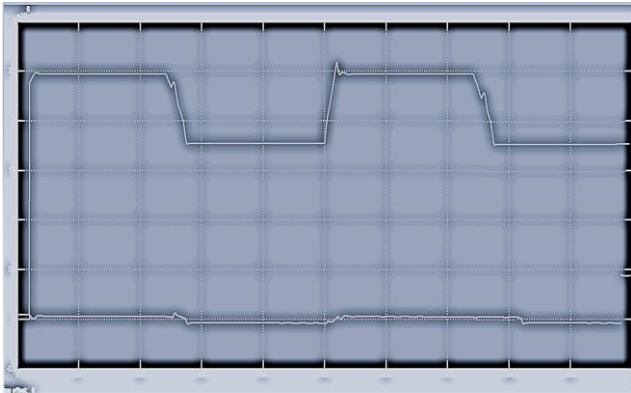


Figure 13: Reactive power Compensation with D-STATCOM.

To mitigate such voltage dip D-STATCOM is used which can easily handle and mitigate such a voltage dip. Reactive power compensation is performed as presented in figure-13.

With the reactive power control the system voltage is maintained for specific level illustrated in Figure- 14 and Figure-15.

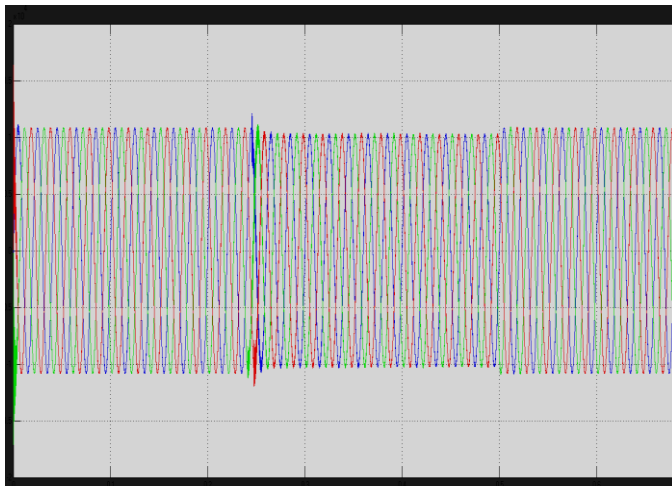


Figure 14: Voltage compensation with D-STATCOM.

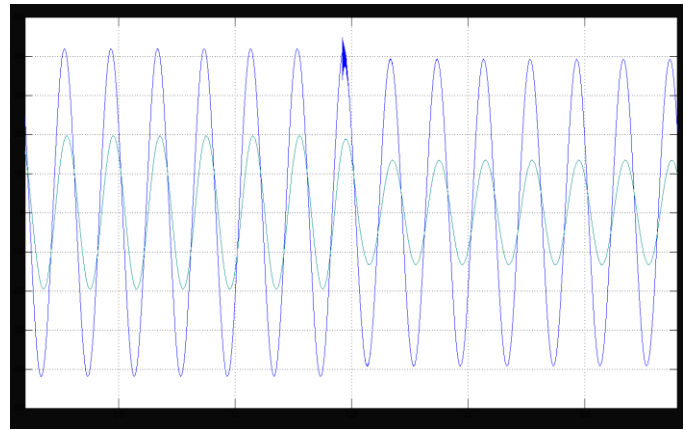


Figure 15: Stable voltage at Load with D-STATCOM.

Now FFT analysis is performed on current and voltage wave form for both control techniques. Without D-STATCOM compensation THD in voltage wave form is 11.345% and 24.1% in current wave form as depict in figure-16 and figure-17. But for high power quality it must be less than 5% according to IEEE-519.

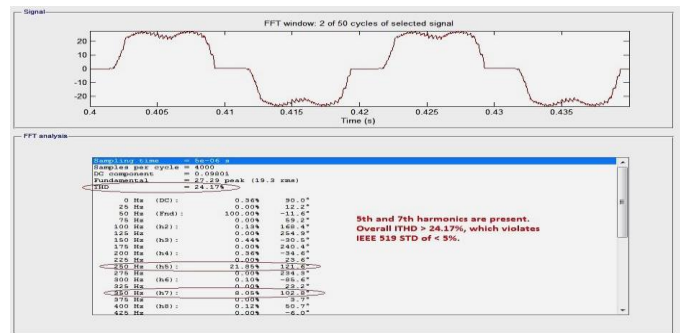


Figure 16: FFT analysis for Current wave form without Compensation.

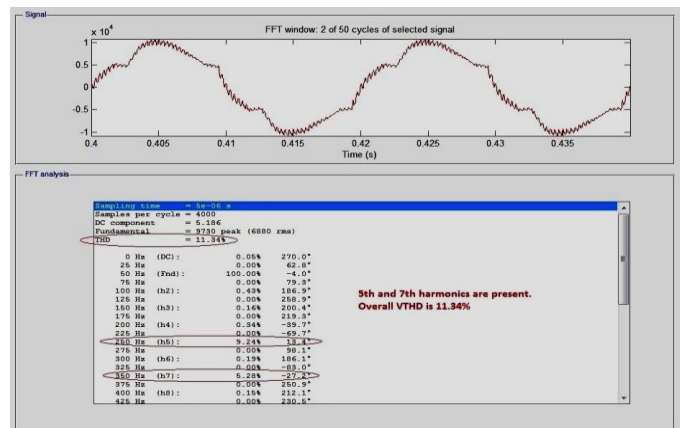


Figure 17: FFT analysis for Voltage wave form without Compensation.

Now D-STATCOM is connected in system with generalized control technique and it is observed voltage and current output in figure-18 and figure-19 respectively, it is clear that THD is less than 5% for both current and voltage.

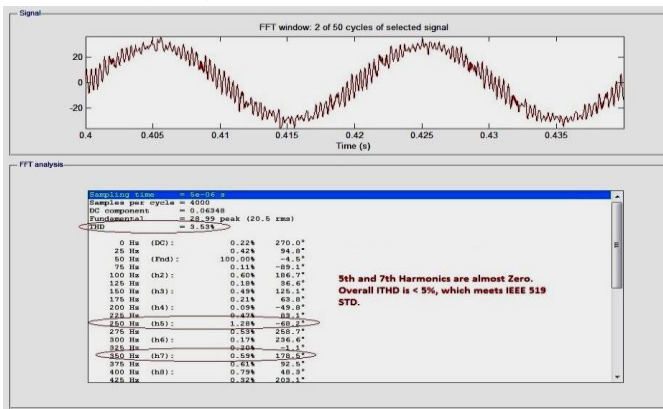


Figure 18: FFT analysis for Voltage wave form with D-STATCOM based on generalized technique.

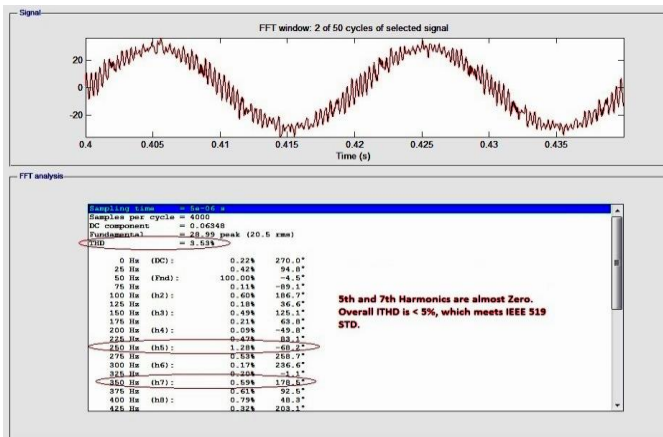


Figure 19: FFT analysis for Current wave form with D-STATCOM based on generalized technique.

Now D-STATCOM is simulated with Park's transformation control scheme and it is witness in figure-20 and figure-21 that THD is reduced to low value effectively.

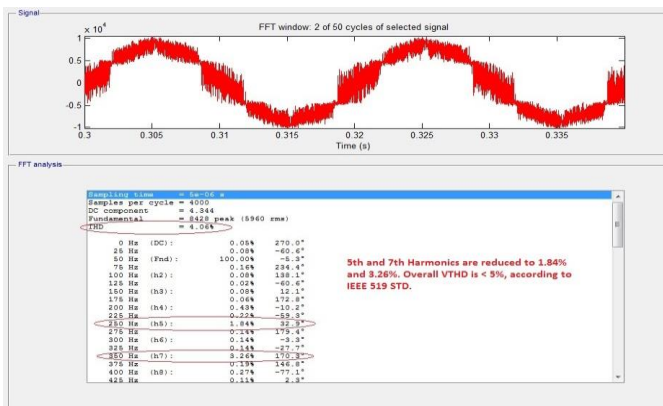


Figure 20: FFT analysis for Voltage wave form with D-STATCOM based on Park's Transformation technique.

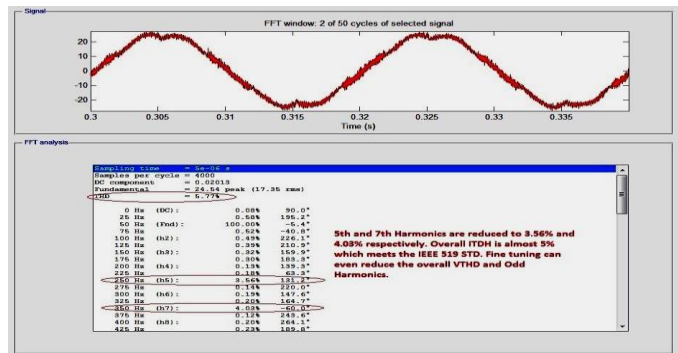


Figure 21: FFT analysis for Current wave form with D-STATCOM based on Park's Transformation technique.

VI. CONCLUSION

The result presented in this paper show that Micro grid concept with DFIG as Renewable Resource can be effectively used with D-STATCOM for improvement of power quality i.e. is voltage stability, harmonic suppression and reactive power control. The power factor can be corrected and two control scheme park's transformation and generalized control scheme are employed to eliminate total harmonics distortion in the system. Regarding future work the FACTS devices control with artificial Intelligence techniques used in micro grid can give more precise control with better power quality.

REFERENCES

- [1] Ritwik Majumder, "Reactive Power Compensation in Single-Phase Operation of Microgrid", IEEE transactions on industrial electronics, vol. 60, no. 4, April 2013.
- [2] Arindam Ghosh and Gerard Ledwich. "Compensation of Distribution System Voltage Using DVR", IEEE TRANSACTION ON POWER DELIVERY. VOL. 17. NO. 4, OCTOBER 2002.
- [3] S.V. Ravi and S.SivaNagaraju. "Simulation of D-statcom and DVR in power System." ARPN Journal of Applied Sciences. VOL. 2, NO. 3, JUNE 2007.
- [4] A. A. Salam, A. Mohamed, M. A. Hannan, "Technical challenges on microgrids", Asian research publishing network journal of engineering & applied sciences, vol. 3 no.6, December 2008.
- [5] M. J. Hossain, H.R Pota, M.A Muhammad and R.A Ramos "Impact of large-scale wind generator penetration on the voltage stability of power systems", IEEE power and energy society General Meeting, PP: 1-8, July 2011.
- [6] F. Lima, D. A. Kleber, J. Dantas and B. Luz, "Reactive power control of DFIG-based wind turbine during voltage sag", 38th Annual Conference on IEEE Industrial Electronics Society, Montreal, Canada, (2012) October 25-28

- [8] Saverio Bolognani, Sandro Zampieri, "Distributed control for optimal reactive power compensation in smart microgrids", 50th IEEE conference on decision and control, European control conference (cdc-ecc), Orlando, FL, USA, December 2011
- [9] Haque, M. H., "Compensation of distribution system voltage sag by DVR and D-STATCOM", Power Tech Proceedings, 2001 IEEE Porto, vol.1, pp.10-13, Sept. 2001.
- [10] R. Mienski, R. Pawelek and I. Wasiak, "Shunt Compensation for Power Quality Improvement Using a STATCOM controller: Modelling and Simulation", IEEE Proce., Vol.151, No.2, March 2004.
- [11] Sethy S. K., J. K. Moharana, "Design, Analysis and Simulation of Linear Model of a STATCOM for Reactive Power Compensation with Variation of DC-link Voltage", International Journal of Engineering and Innovative Technology (IJEIT), vol. 2, issue 5, November 2012.
- [12] Singh Bhim, Al-Haddad K., Chandra A., "A new control approach to three-phase active filter for harmonics and reactive power compensation," *Power Systems, IEEE Transactions on* , vol.13, no.1, pp.133,138, Feb 1998.